

**SLIP RESISTANCE
TEST REPORT**

Project : **Slip Resistance Investigation**
 Location of Test : **Auckland Laboratory**
 Client : **Matta Products Ltd**
 Slider type : **FOUR-S, Prepared on P 400 (or equivalent) sand paper.**
 Specimen Description : **Play MATTA '015805'**

Cleaning Procedure : **Wet Brush**
 Test Type : **unfixed**
 Air Temp at Test (°C) : **21**

Project Number :	1-LA391.00
Lab Ref. Number :	AL3101/2
Client Ref. Number :	-


SLIP RESISTANCE TEST RESULTS			
Specimen № :	Test Direction :	Mean BPN :	Mean Coefficient of Friction* :
1	N/A	55	0.60
2		55	0.60
3		55	0.60
4		56	0.61
5		55	0.60
Average :		55	0.60
Classification of pedestrian surface material in accordance with table 2, AS 4586:2013 :			P5

TEST METHOD

Tests were carried out in accordance with Appendix A, AS 4586:2013, the classification is based on a test in the wet condition.

*Coefficient of friction obtained from: AS/NZS 3661.1 : 1993 Slip Resistance of Pedestrian Surfaces.

TEST POSITION DIAGRAM

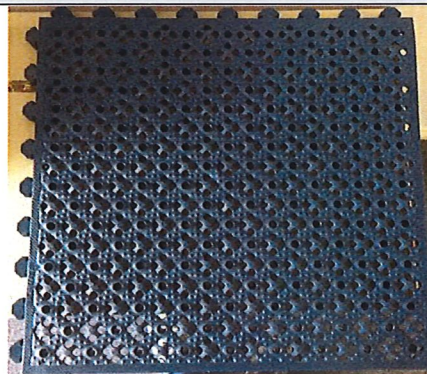

Tested By : **OPUS - G. Sandford**
 Designation : **Civil Engineering Technician**
 Date Tested : **1/10/18**

LAF026 (06/18)